


# DRINKING WATER

## Tritium Concentrations in the CFA Wells and Distribution System (1994 through 1<sup>st</sup> quarter 2004)

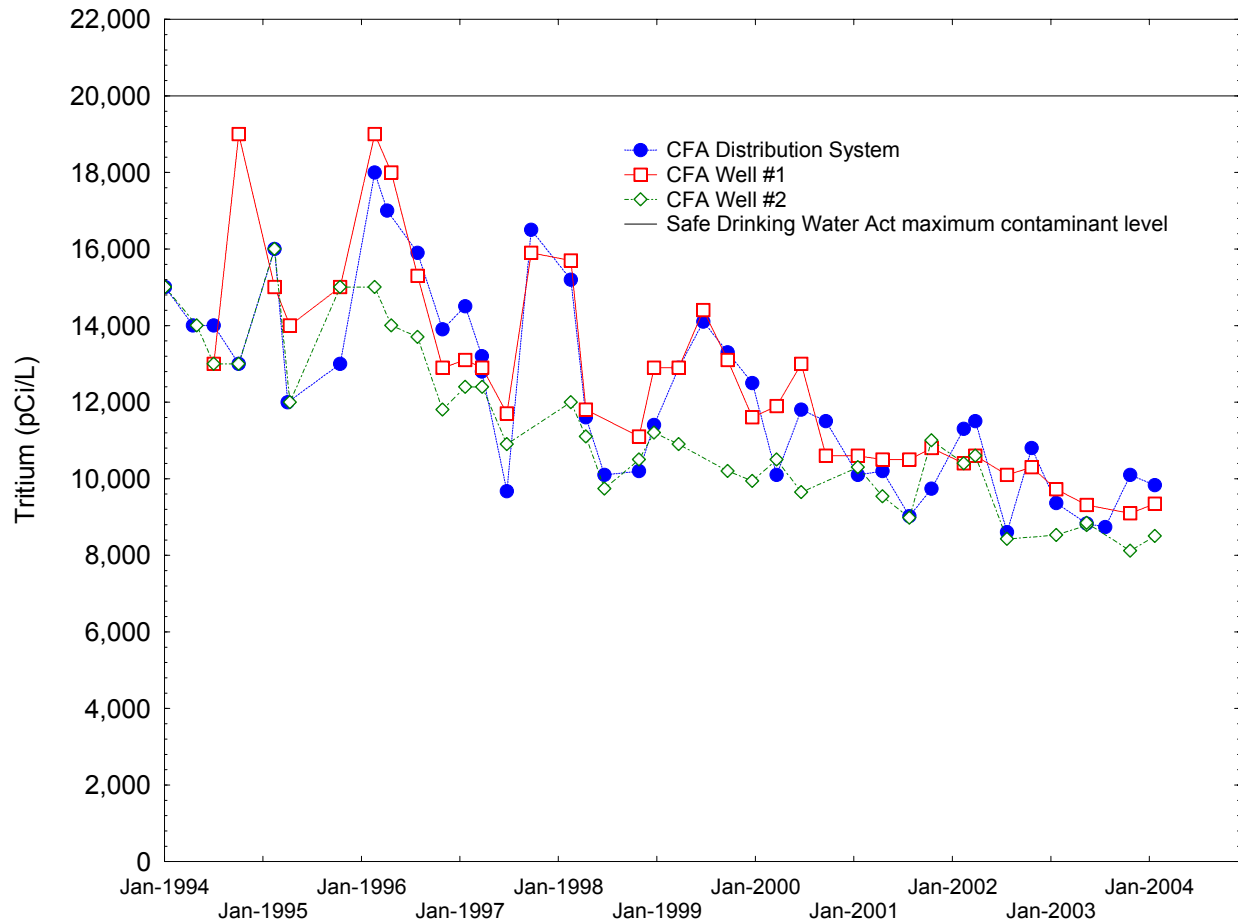

The point of compliance is the CFA Distribution System, which has historically been below the maximum contaminant level.

### FOR MORE INFORMATION

Contact: Roger Wilhelmsen  
208-526-9401  
[rnw@inel.gov](mailto:rnw@inel.gov)